


CFR Insulated Roof Panel High Eave

Page
MBCFR050

Date
Jun '16

Rev
00

2" Long Tape Sealer $\frac{1}{4}$ " x 1"
7405 Place Under Male leg
and 3" Long Tape Sealer
 $\frac{1}{4}$ " x 1" 7405 Place on top
of Male leg

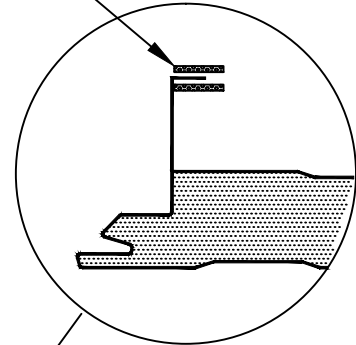

Urethane Tube Sealant
HW540 Each end at
Upslope Side of Closure
to Fill Voids as Necessary

Fastener #4
 $\frac{1}{4}$ -14 x $\frac{7}{8}$ " LL SD W/Washer
at 8" O.C.

Tape Sealer $\frac{1}{4}$ " x 1" 7405

Clip Sealant Tape 7412

CFR Insulated Roof Panel

Outside Closure
7900 - 42" Panel
7902 - 36" Panel
7901 - 30" Panel

Tape Sealer $\frac{3}{16}$ " x $\frac{1}{2}$ " 7403
Continuous Bottom of
Closure and at Closure Ends

Back-up Plate, Factory
Installed at Each High
Mesa 4" O.C.

Fastener #1E
 $\frac{1}{4}$ -14 x $1\frac{1}{4}$ " LL SD W/Washer
at Each Back-up Plate
(4" O.C.)

High Eave Trim

Loose Fill Insulation or
Field Applied Foam
(Not by MBCI)

Fastener #4A
 $\frac{1}{4}$ -14 x $\frac{7}{8}$ " SD W/Washer
at 8" O.C.

Tape Sealer $\frac{1}{4}$ " x 1" 7405
Continuous (Not required at
Fluted Wall Panel)

Outside Closure 7607 for
Fluted Panel Only

Insulated CF Metal
Wall Panel

2"
Panel
Thickness

Panel Clip

Clip Fasteners
(Quantity as Specified)

Non-Skinning Butyl Tube
7100 $\frac{3}{8}$ " Bead With Marriage
Bead to Panel Joint

Clip Fasteners
Minimum (2) Required

Eave Strut

Wall Panel Clip 4633
at Panel Side Joint

Panel
Thickness